


CITY: SYRACUSE DIV: GROUP: ENV DB: A SANCHEZ ID: ALS/GMS PIC: C.S.PETERS PM: C.KIKER TM: C.KIKER LVR: ON-OFF-REF
 C:\Users\alsanchez\OneDrive - ARCADIS\BIM 360 Docs\RACER TRUST\BUICK CITY PCRA\2018\06\410_201801-DWG\RTBC-F-SITE SAMPLE NETWORK.dwg LAYOUT: 1. SAVED: 7/27/2018 12:12:41 AM ACADVER: 21.05 (LMS TECH) PAGES: 1 OF 1 PLOTTED: 10/24/2018 4:33 PM BY: SANCHEZ, ADRIAN
 IMAGES: PROJECTNAME: ---

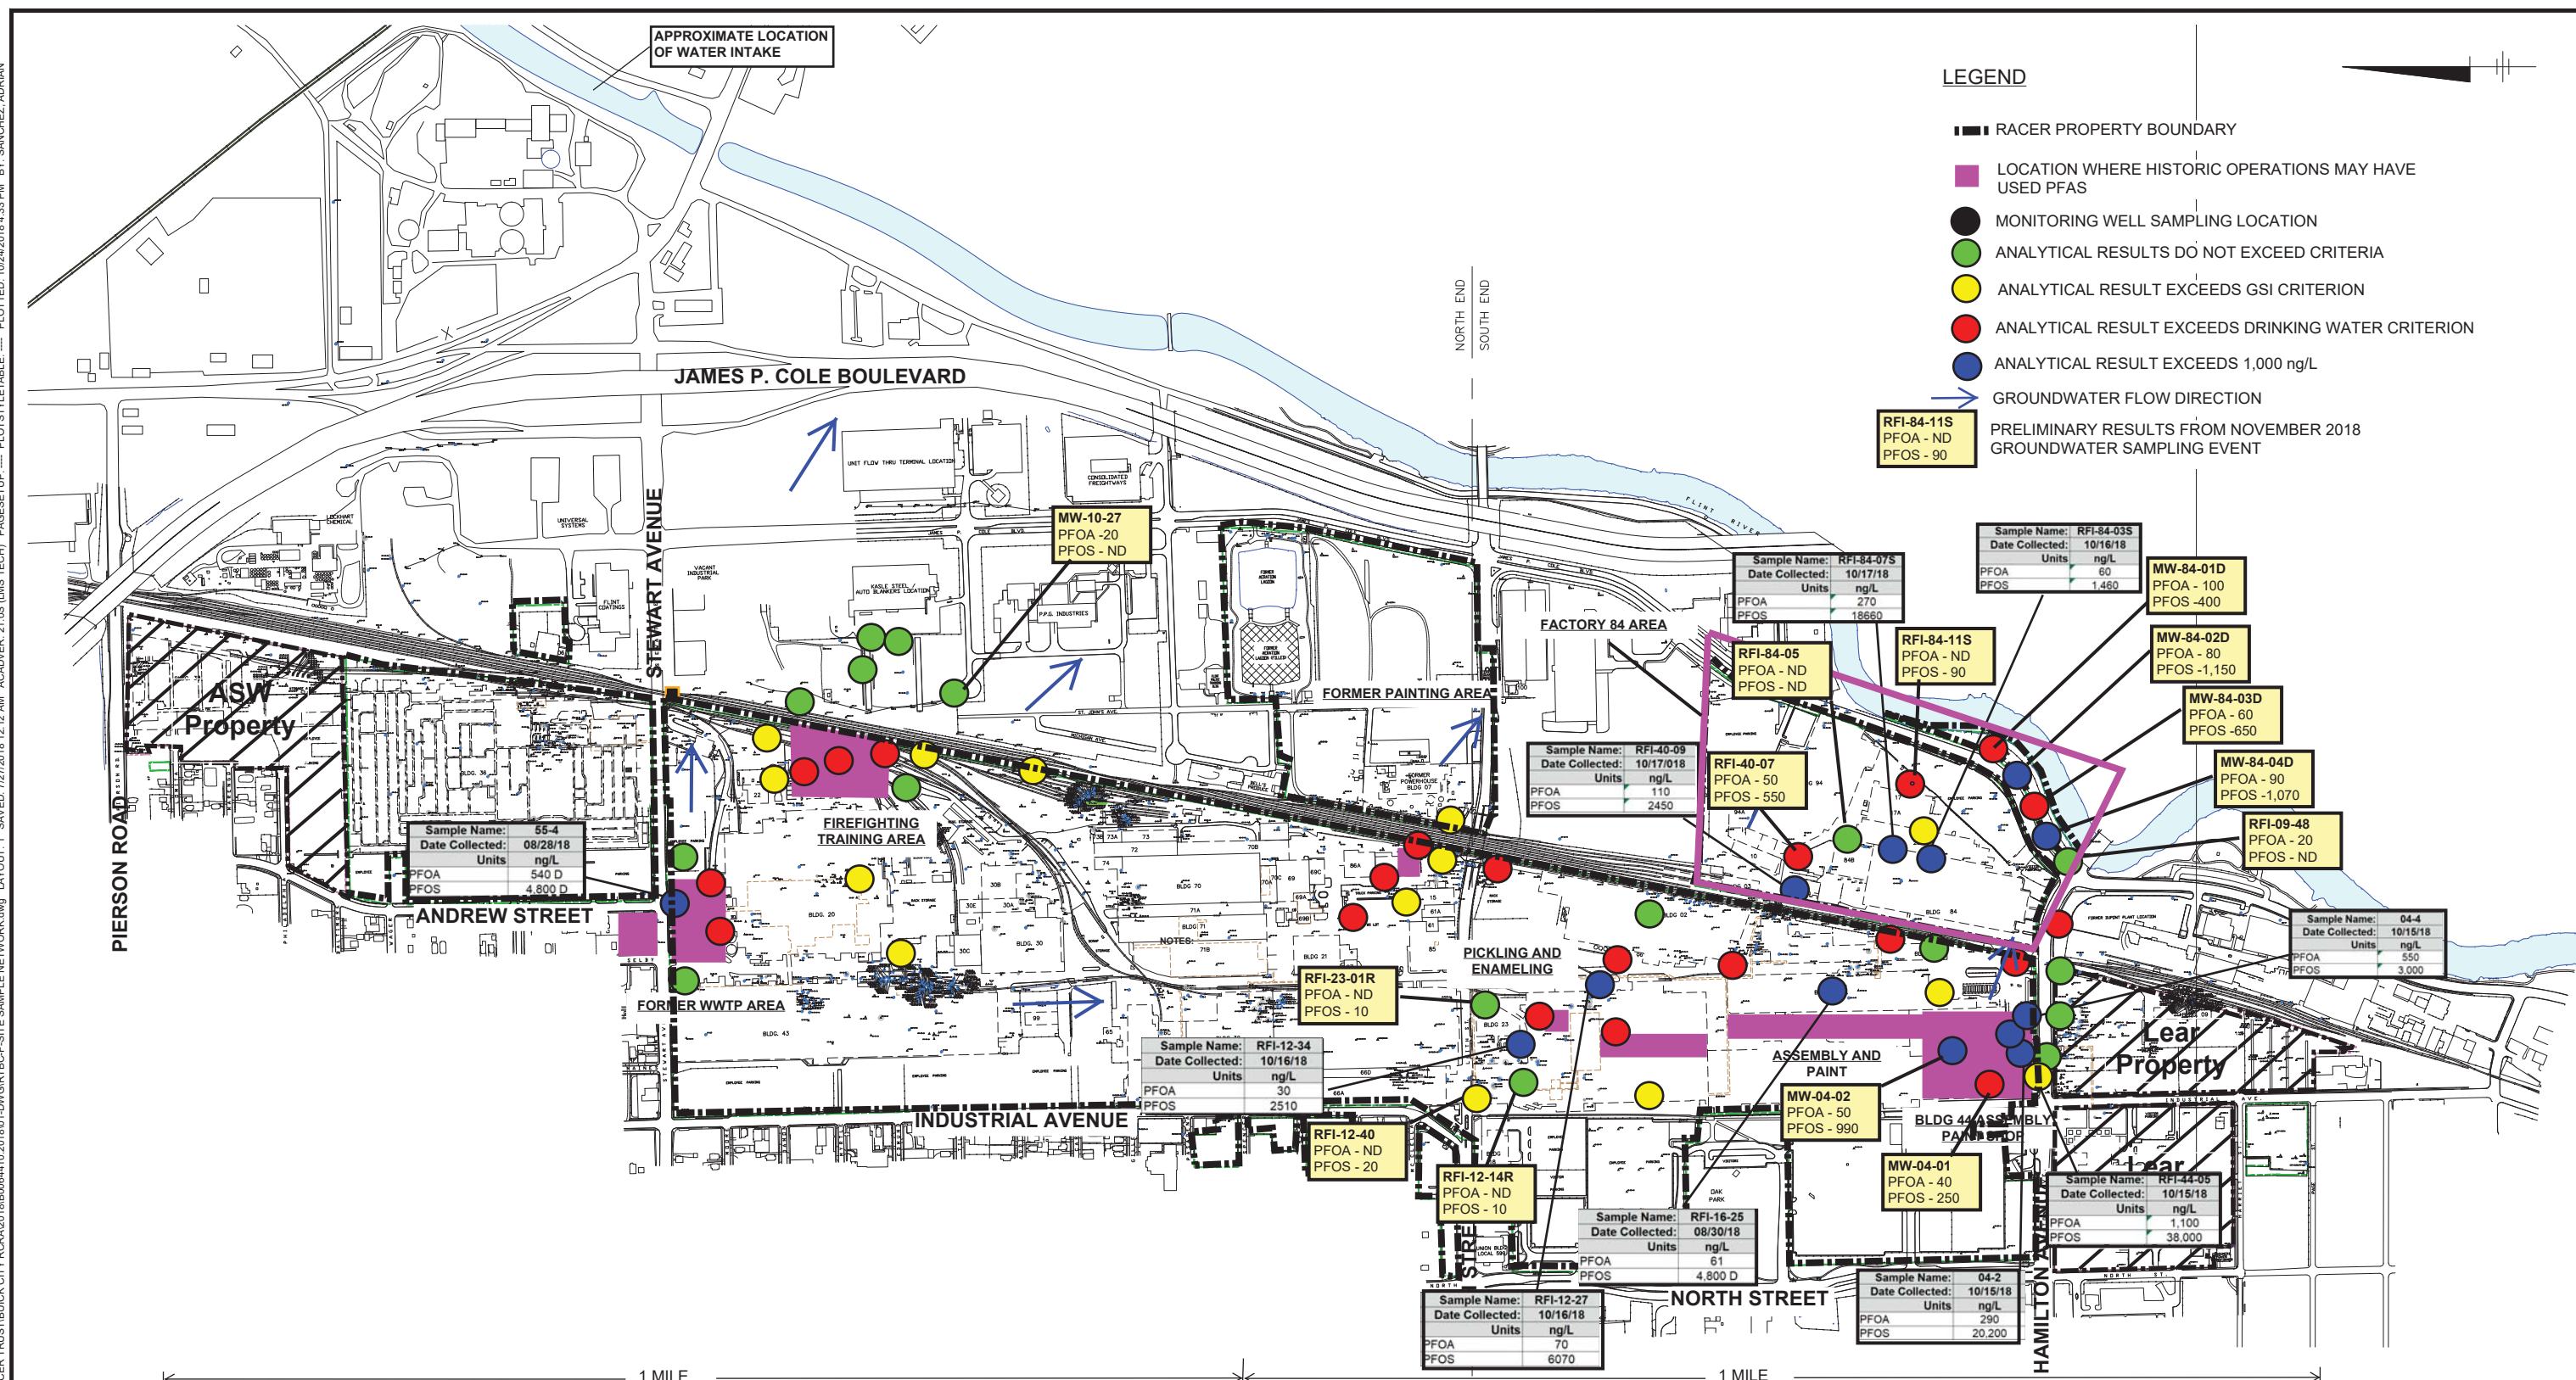

LEGEND

- RACER PROPERTY BOUNDARY
- LOCATION WHERE HISTORIC OPERATIONS MAY HAVE USED PFAS
- MONITORING WELL SAMPLING LOCATION
- ANALYTICAL RESULTS DO NOT EXCEED CRITERIA
- ANALYTICAL RESULT EXCEEDS GSI CRITERION
- ANALYTICAL RESULT EXCEEDS DRINKING WATER CRITERION
- ANALYTICAL RESULT EXCEEDS 1,000 ng/L
- GROUNDWATER FLOW DIRECTION
- RFI-84-11S
PFOA - ND
PFOS - 90
- PRELIMINARY RESULTS FROM NOVEMBER 2018 GROUNDWATER SAMPLING EVENT

NOTES:

1. Base map information from a survey by BMJ, INC dated April 2001 at a scale of 1:100. Aerial image ARCGIS 10 Online Mapping, accessed 6/12/2013. Additional information digitized from aerial imagery, 2018 Microsoft corporation, 2018 DigitalGlobe, CNES (2018) distribution airbus DS, Bing.
2. PFOA - perfluorooctanoic acid
3. PFOS - perfluorooctane sulfonic acid
4. ng/L - nanograms per liter
5. U - Analyte not detected above the reporting limit
6. D - Concentration is based on a diluted sample analysis

RACER TRUST
 BUICK CITY
 FLINT, MICHIGAN

**NOVEMBER 2018 PRELIMINARY PFAS
 GROUNDWATER SAMPLING RESULTS**