

Table 1. Soil Vapor Results, N. Capitol Court Road (Summer 2024 - Spring 2026)										
Sample Location	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE EPA VISL (µg/m³)
	6/10/24	6/14/24	8/16/24	11/18/2024 & 11/19/2024	3/6/2025 & 3/7/2025	8/4/2025	11/6/2025	1/26/2026	4/13/2026	
NV-28	16	8.4	<0.64	1.5	<0.64	<0.64	<11	<11 (<11)	<11	70
NV-29	<1.0	0.64	0.64	1.7	<0.64	<0.64	<11	<11	<11	
NV-30	45	46	62	47	14 (14)	1.3	<11	<11	<11	
NV-31	150	110	7.3	3.2 (4.3)	6.4	5.4	<11	<11	<11	
NV-32	<1.0	<1.0	<0.64	<0.64	<0.64	<0.64	<11	<11	<11	

LEGEND

-  GROUNDWATER MONITORING WELL LOCATION
-  SOIL VAPOR SAMPLING LOCATION
- TCE TRICHLOROETHENE
- (14) BLIND DUPLICATE SOIL VAPOR SAMPLE RESULTS SHOWN IN PARENTHESES
- EPA U.S. ENVIRONMENTAL PROTECTION AGENCY
- VISL VAPOR INTRUSION SCREENING LEVEL (SOIL VAPOR, RESIDENTIAL)

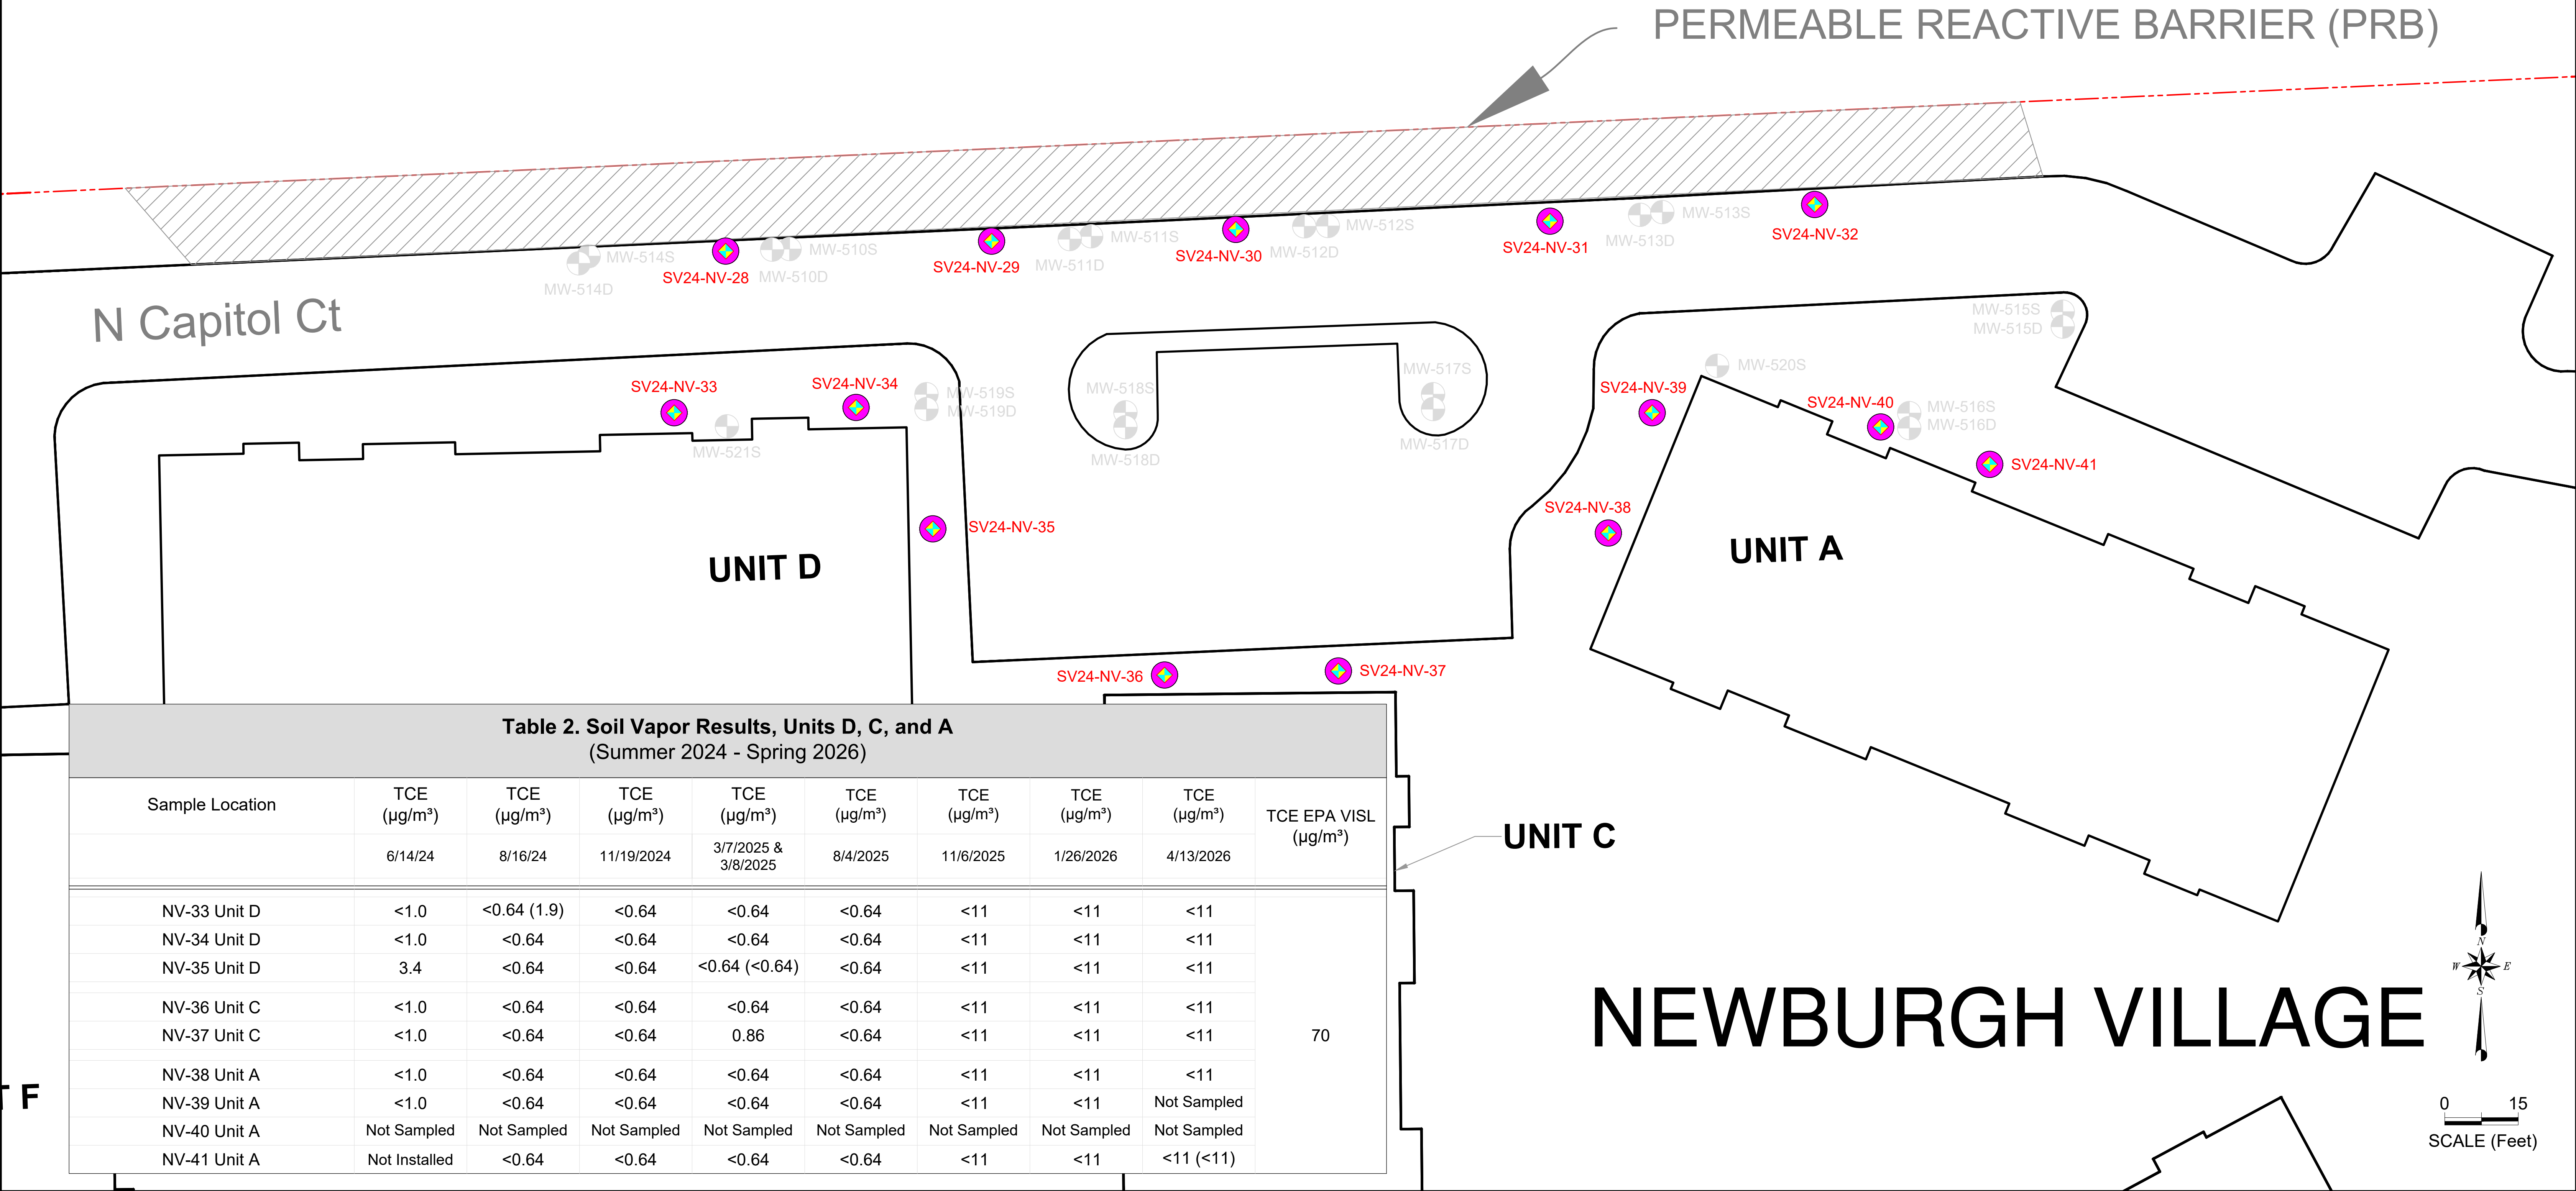


Table 2. Soil Vapor Results, Units D, C, and A (Summer 2024 - Spring 2026)									
Sample Location	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE (µg/m³)	TCE EPA VISL (µg/m³)
	6/14/24	8/16/24	11/19/2024	3/7/2025 & 3/8/2025	8/4/2025	11/6/2025	1/26/2026	4/13/2026	
NV-33 Unit D	<1.0	<0.64 (1.9)	<0.64	<0.64	<0.64	<11	<11	<11	70
NV-34 Unit D	<1.0	<0.64	<0.64	<0.64	<0.64	<11	<11	<11	
NV-35 Unit D	3.4	<0.64	<0.64	<0.64 (<0.64)	<0.64	<11	<11	<11	
NV-36 Unit C	<1.0	<0.64	<0.64	<0.64	<0.64	<11	<11	<11	
NV-37 Unit C	<1.0	<0.64	<0.64	0.86	<0.64	<11	<11	<11	
NV-38 Unit A	<1.0	<0.64	<0.64	<0.64	<0.64	<11	<11	<11	
NV-39 Unit A	<1.0	<0.64	<0.64	<0.64	<0.64	<11	<11	Not Sampled	
NV-40 Unit A	Not Sampled	Not Sampled	Not Sampled	Not Sampled	Not Sampled	Not Sampled	Not Sampled	Not Sampled	
NV-41 Unit A	Not Installed	<0.64	<0.64	<0.64	<0.64	<11	<11	<11 (<11)	